SNOHOMISH

Material Standards

Revision 1 Mar 11, 2021

1. Scope

This specification applies to precast concrete open bottom and enclosed vaults that are 5' W x 9' L and their corresponding concrete covers and pads specifically for electrical use.

2. Material ID Numbers

The following vault Cat. ID's shall conform to the corresponding diagram dimensions:

2.1 Vaults and Vault Assemblies

Material ID	Description	Section
790544	5'0 x 9'0 x 5'10, bottom (2) pieces without cover	9.1

2.2 Covers and Pads

Material ID	Description	Section
790552	5'0 x 9'0 x 1'4, with 50" x 54" opening and 24" x 36" hatch for livefront switch cabinets	9.4
790578	5' x 9' x 16" w/ (2) 36" sq. Diamond Plate Hatches	9.1
790594	5' x 9' x 16" w/ (2) 3' x 3' Vent/Grates	9.2
1002612	6'8 x 9'6 x 1'5, with 58" x 66" opening and 2' x 3' hatch for PMH to PME switch conversion on 5'0 x 9'0 vaults	9.3

2.3 RISERS

MID	Description	Section
5001530	5'6 x 9'6 x 1'0, for 5'0 x 9'0 vaults	9.5

3. Referenced Standards

All material, accessories, and marking for District vaults, pads, and covers shall adhere to the specifications of District Material Standard VAULTMAT1.

4. Pulling Irons

Vaults shall be equipped with 5/8" pulling irons located in the lower corners, unless otherwise specified by the District.



Material Standards

790544.1 5' x 9' Precast Concrete Vaults and Associated Pads and Covers

5. Interior Equipment Mounting Hardware

All vaults shall be equipped with interior equipment mounting hardware.

6. Lifting Inserts

All vaults, covers, and risers shall be equipped with Burke-type lifting inserts as appropriate for the structure's weight.

7. Identification

All vaults, covers, and pads shall be marked in compliance with VAULTMAT1.

8. Hatch Covers

All hatch covers shall be constructed of H-20 rated Diamond Plate unless otherwise specified by the District. In individual cases where this is not sufficient, the District shall have the option to specify a Port Authority rating and/or a SlipNot™ finish.

9. Dimensions


Vaults, pads, and covers shall have the following dimensions and knockout distribution (where applicable). Note that multiple covers may fit each vault and that covers may have the same dimensions with different accessories, i.e. Diamond Plate Hatch vs. Steel Plate w/ SlipNot™ Hatch.



790544.1 5' x 9' Precast Concrete Vaults and Associated Pads and Covers

9.1


5' x 9' x 7'2" (3 pc) including 5' x 9' x 16" Cover w/ (2) 36" sq. Diamond Plate Hatches

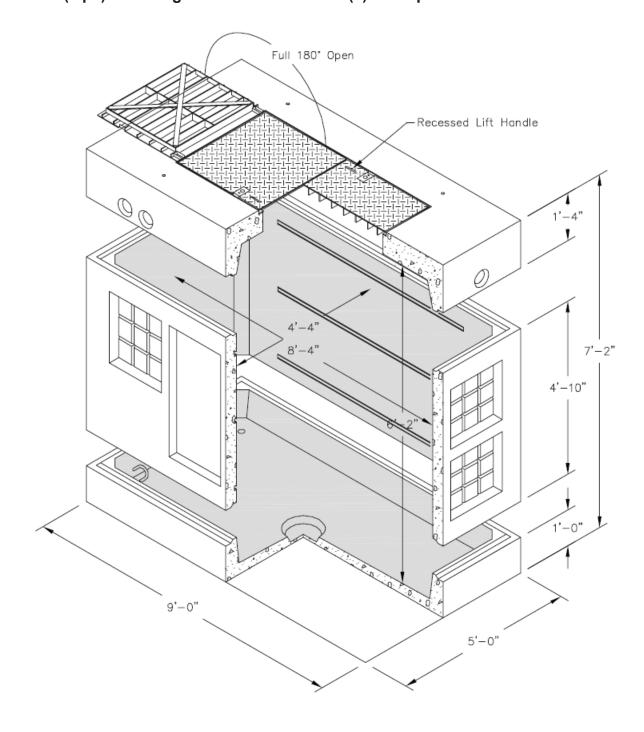

Material Standards

9.2


5' x 9' x 16" w/ (2) 3' x 3' Vent/Grates

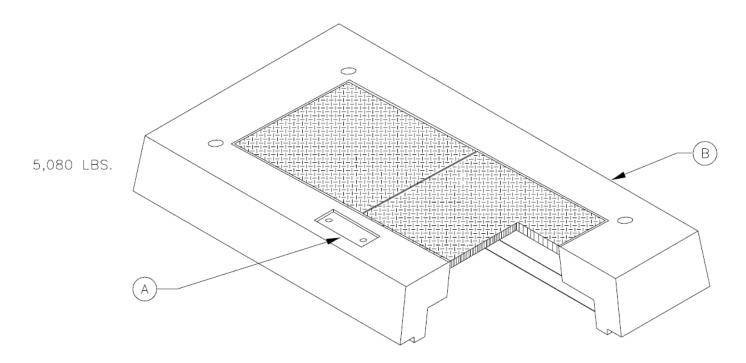



9.3

6'8 x 9'6 x 1'5, with 58" x 66" opening and 2' x 3' hatch for PMH to PME switch conversion on 5'0 x 9'0 vaults

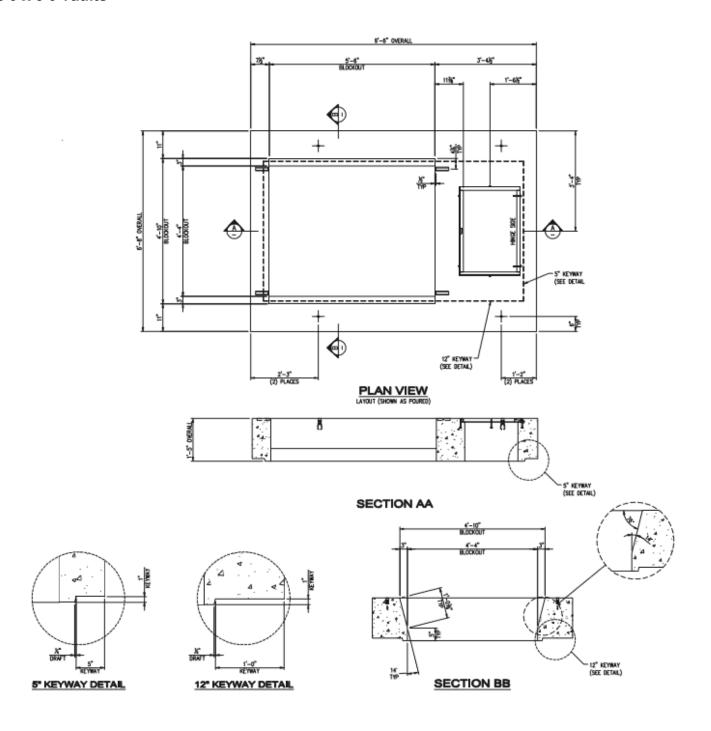




790544.1 5' x 9' Precast Concrete Vaults and Associated Pads and Covers



9.4

5'0 x 9'0 x 1'4, with 50" x 54" opening and 24" x 36" hatch for livefront switch cabinets

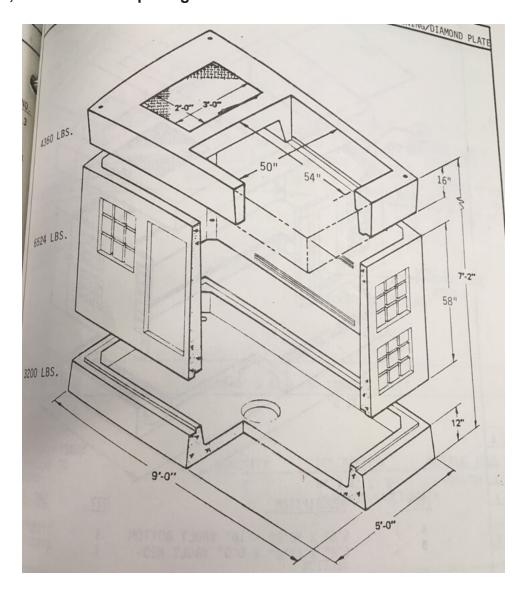

Material Standards

790544.1 5' x 9' Precast Concrete Vaults and Associated Pads and Covers

9.5

5'6 x 9'6 x 1'0, for 5'0 x 9'0 vaults

